


REDUCTION OF BACTERIA

IN 5-STAR HOTEL ROOMS

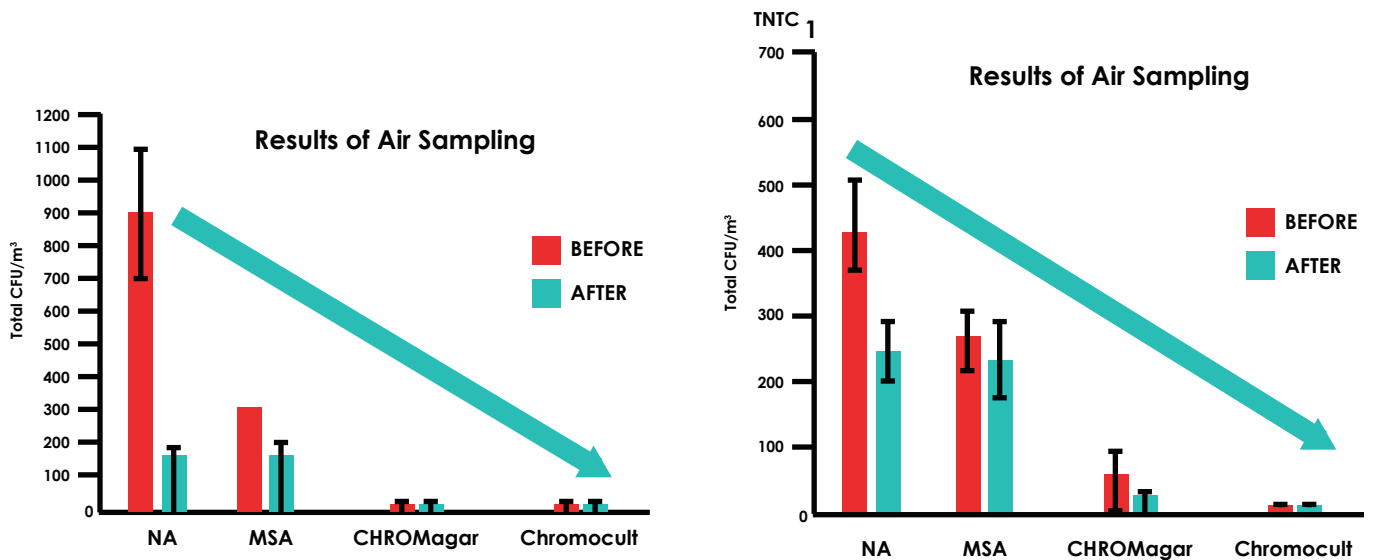

Field test location:

Two hotel rooms in Malaysia.

Conducted by:

The School of Science, Monash University Sunway Campus, Malaysia

Test method:

Air samples were taken before and after switching on the Medklinn PRO AS2 Air+Surface Sterilizer, 8 days; Air Monitoring - Total Aerobic Plate Count.

Test results:

The results suggest that the bacterial load on surfaces and the air in the hotel room were markedly reduced after switching on the Medklinn Air+Surface Sterilizer continuously for 8 days.